





Box 93
283 22 Osby
Sweden
Tel. +46 (0) 479-17700

Företag/Company	OSBY PARCA		
Beskrivning/Description	EI 160 Eco 156 kW 400V		
Ritnings nr./Drawing nr.	R1017020		
Revision	Rev E		
Fält/Field			
Fabrikat/Product			
Typ/Type	Elpanna 156 kW 400V		
Installation			
Projektansvarig/Project manager			
Delegenskap/Other			
Skapad/Created	2019-10-09		
Redigerad/Edited	2020-11-10	Av/By rni	Antal sidor 9

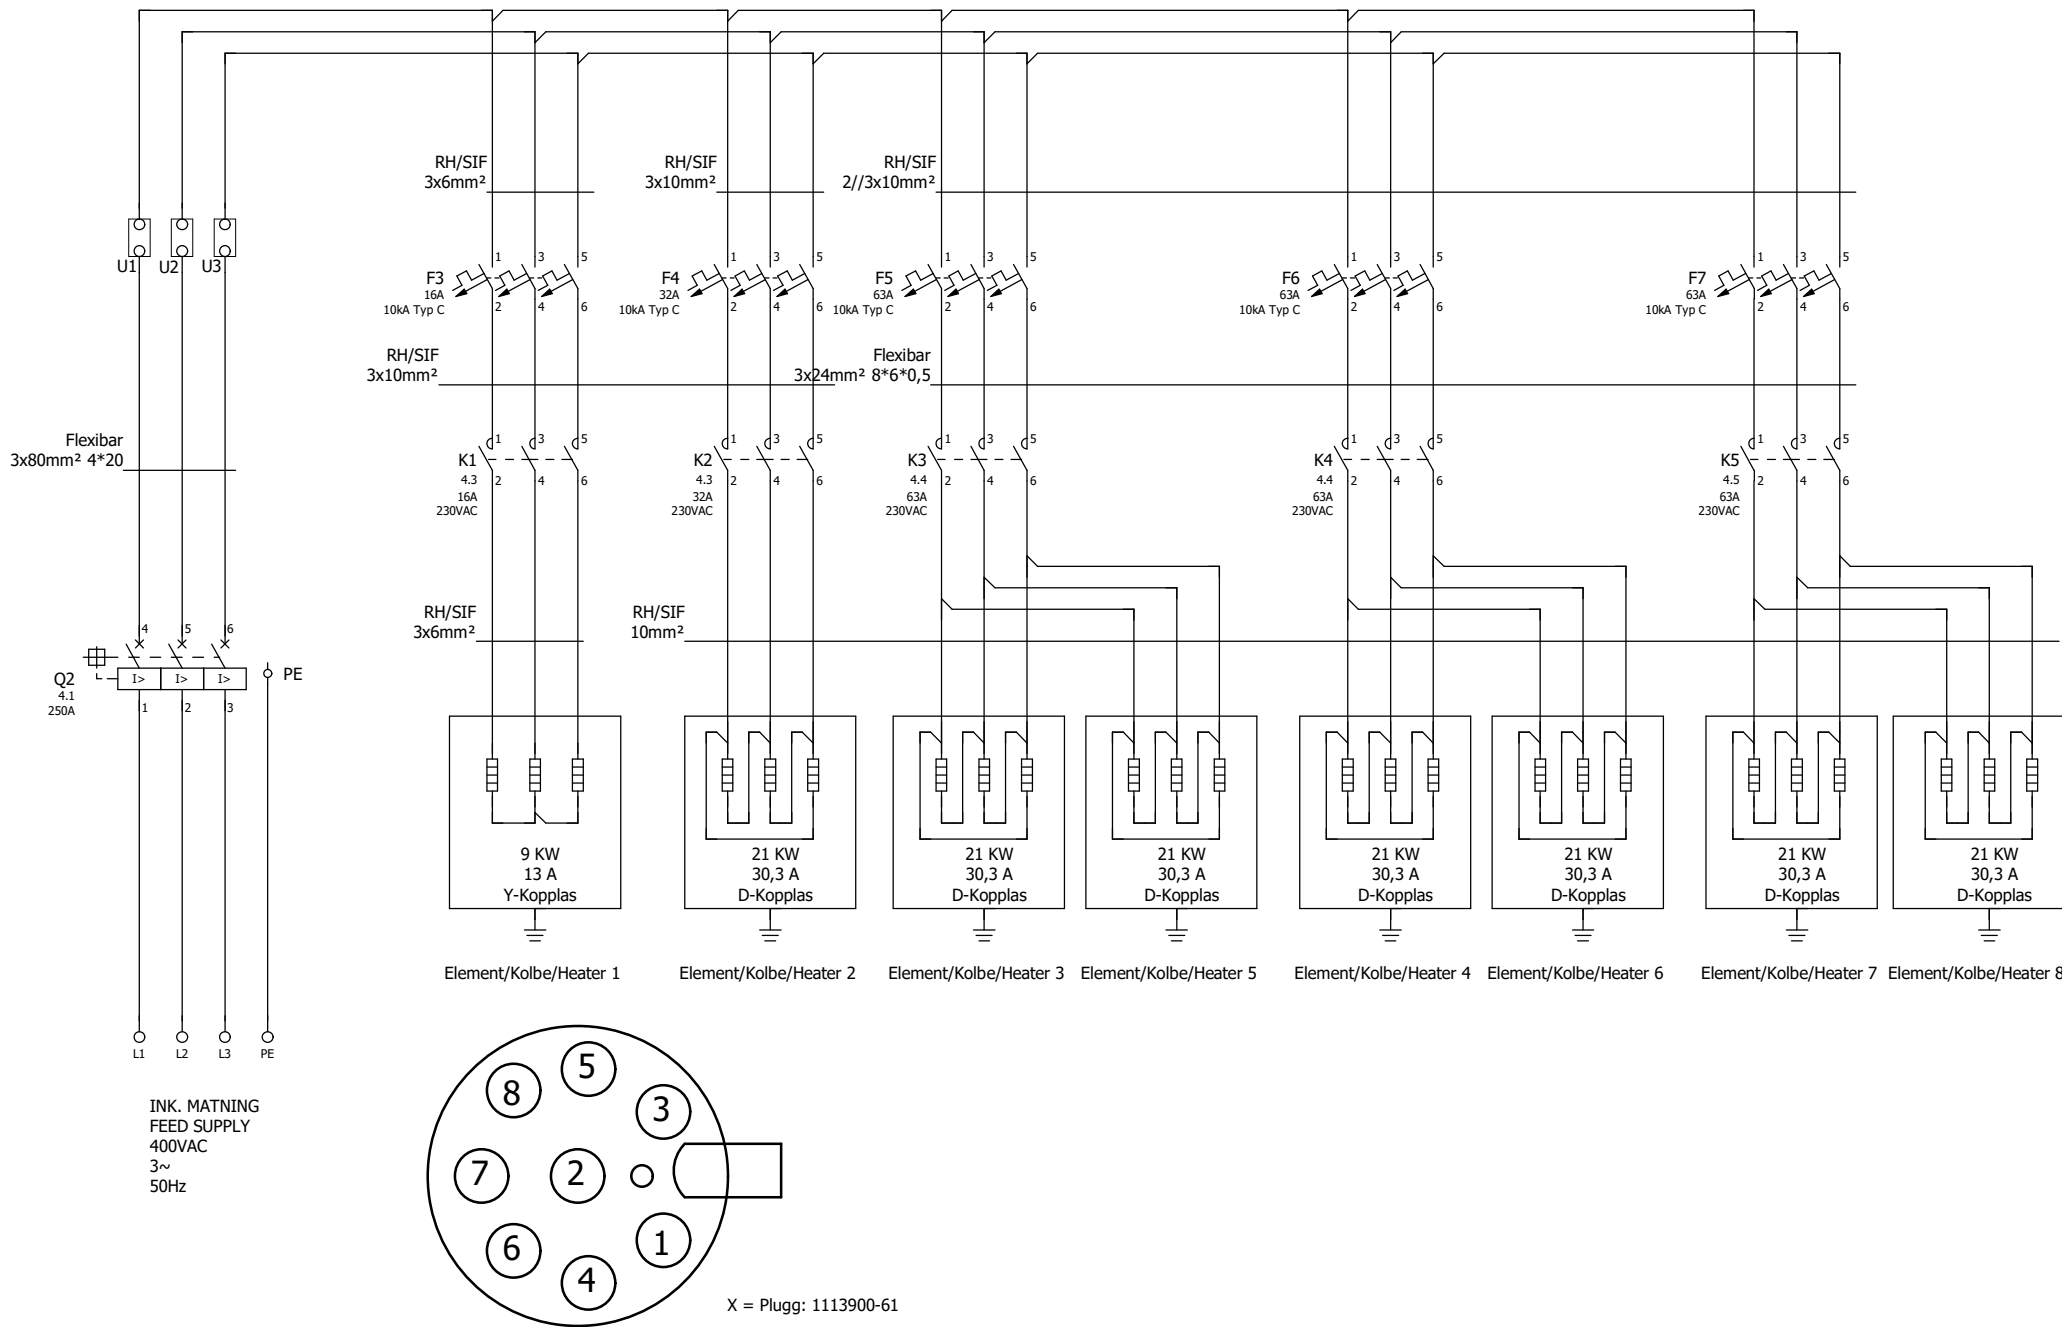

INK. MATNING/MATING
FEED SUPPLY
230VAC
1~
50Hz


SVART=BLACK
L.BLÅ=LIGHT BLUE
BRUN=BROWN
G/G=PROTECTIVE EARTH
BYGEL=JUMPER

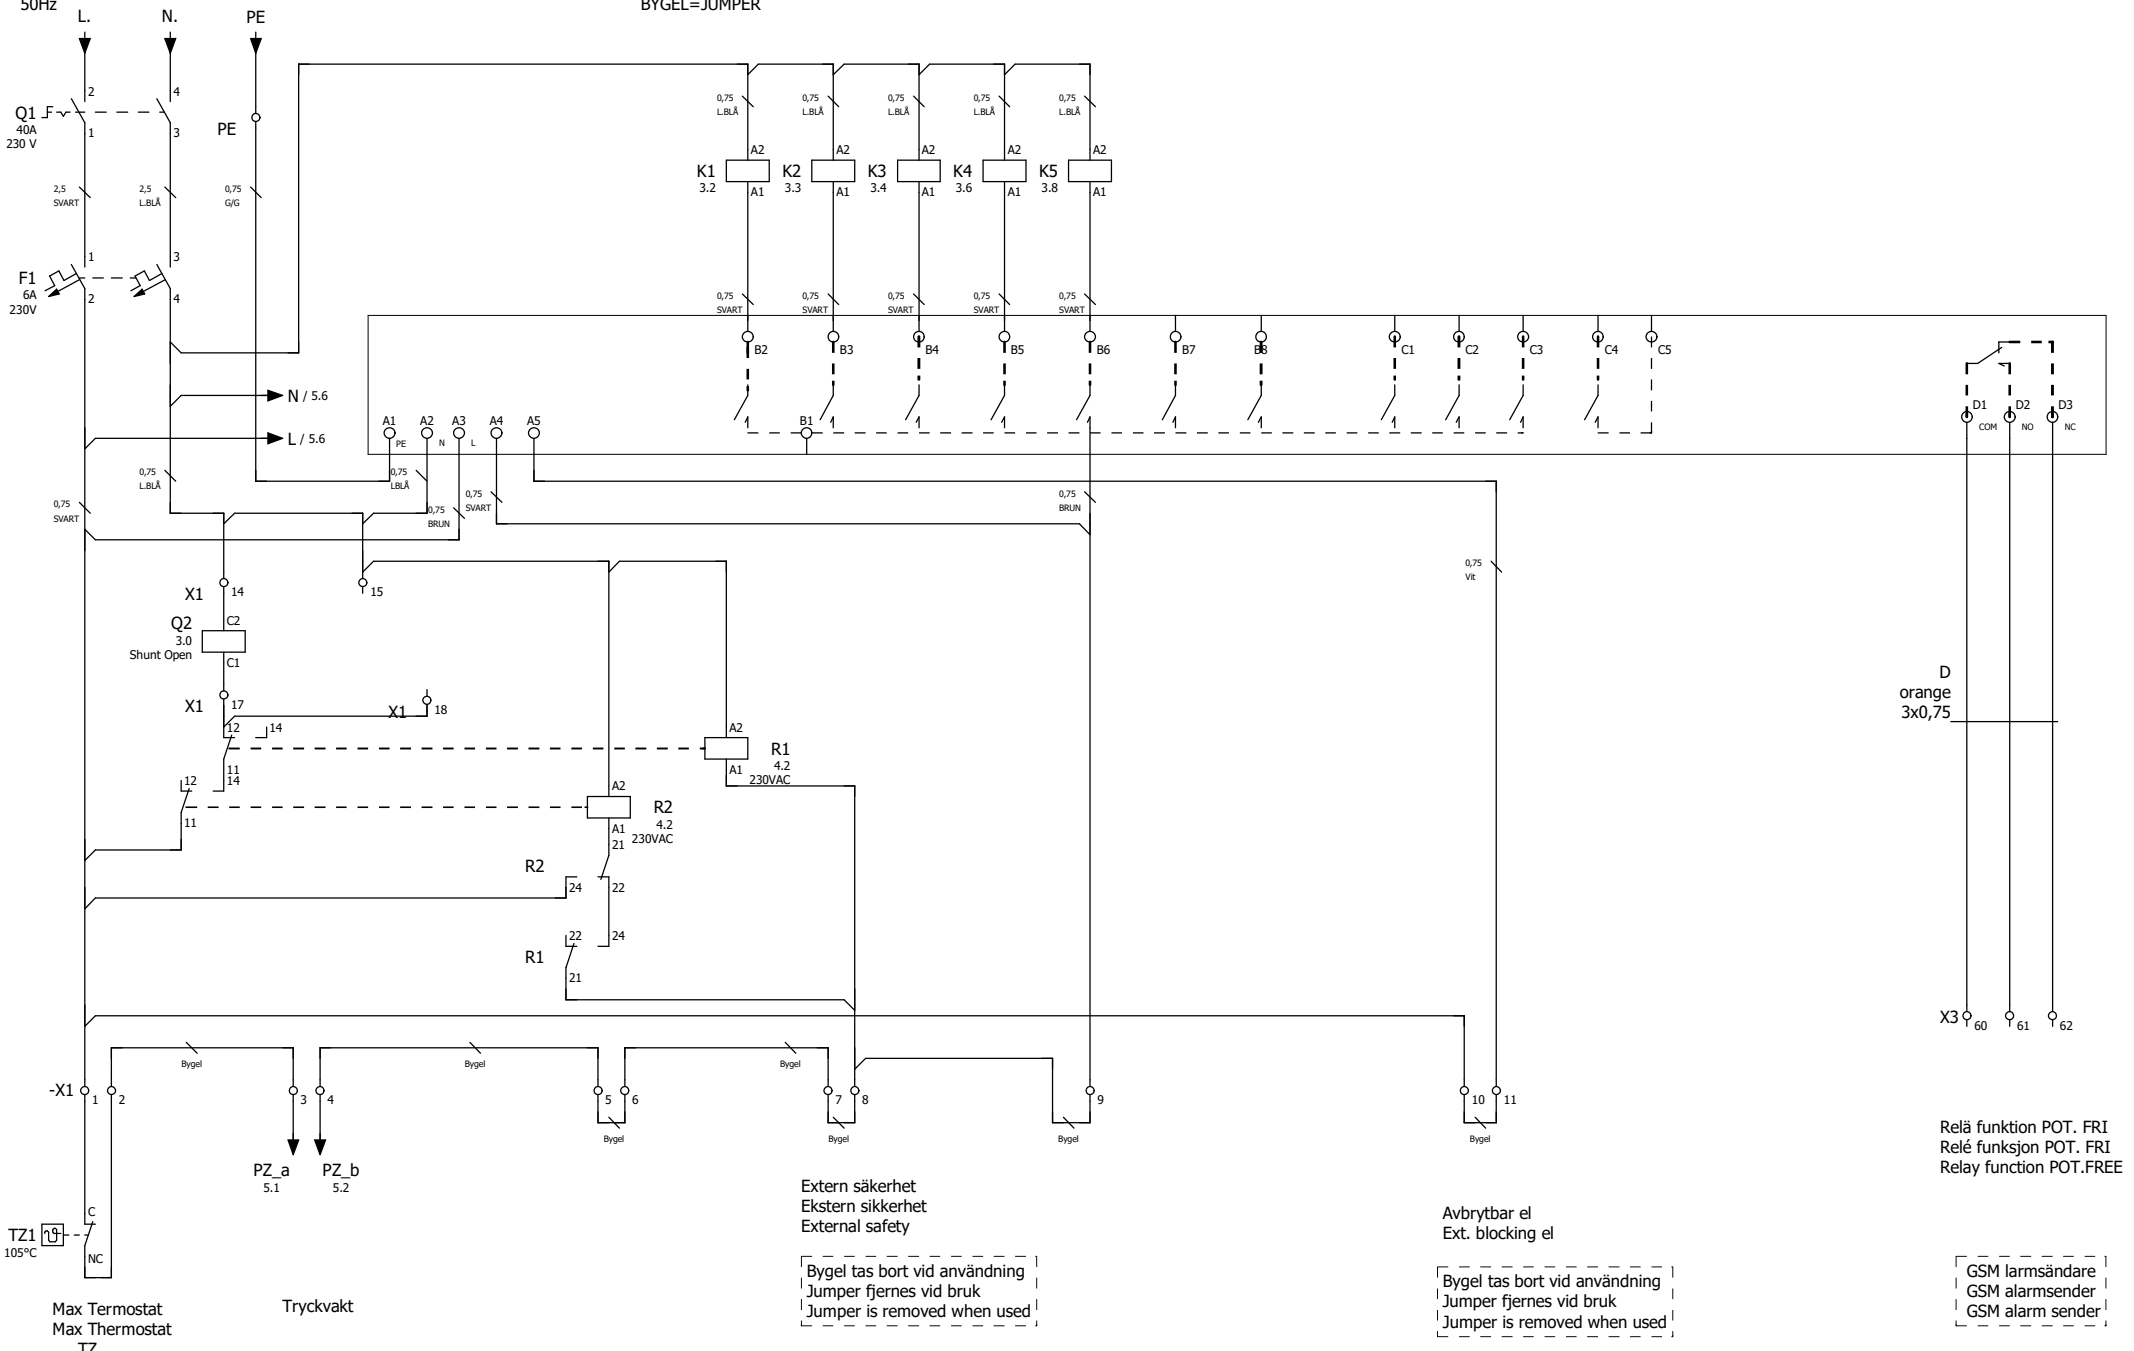



Relä funktion POT. FRI
Relé funksjon POT. FRI
Relay function POT.FREE

GSM larmsändare
GSM alarmsender
GSM alarm sender

Gäller panna med inbyggd tryckvakt.
Valid for boiler equipped with pressure switch

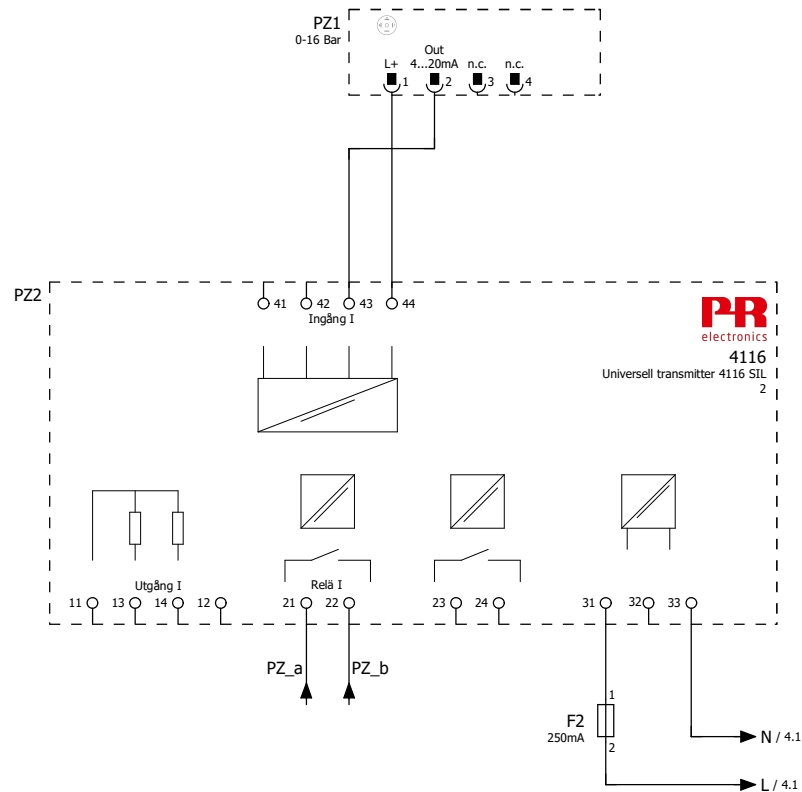

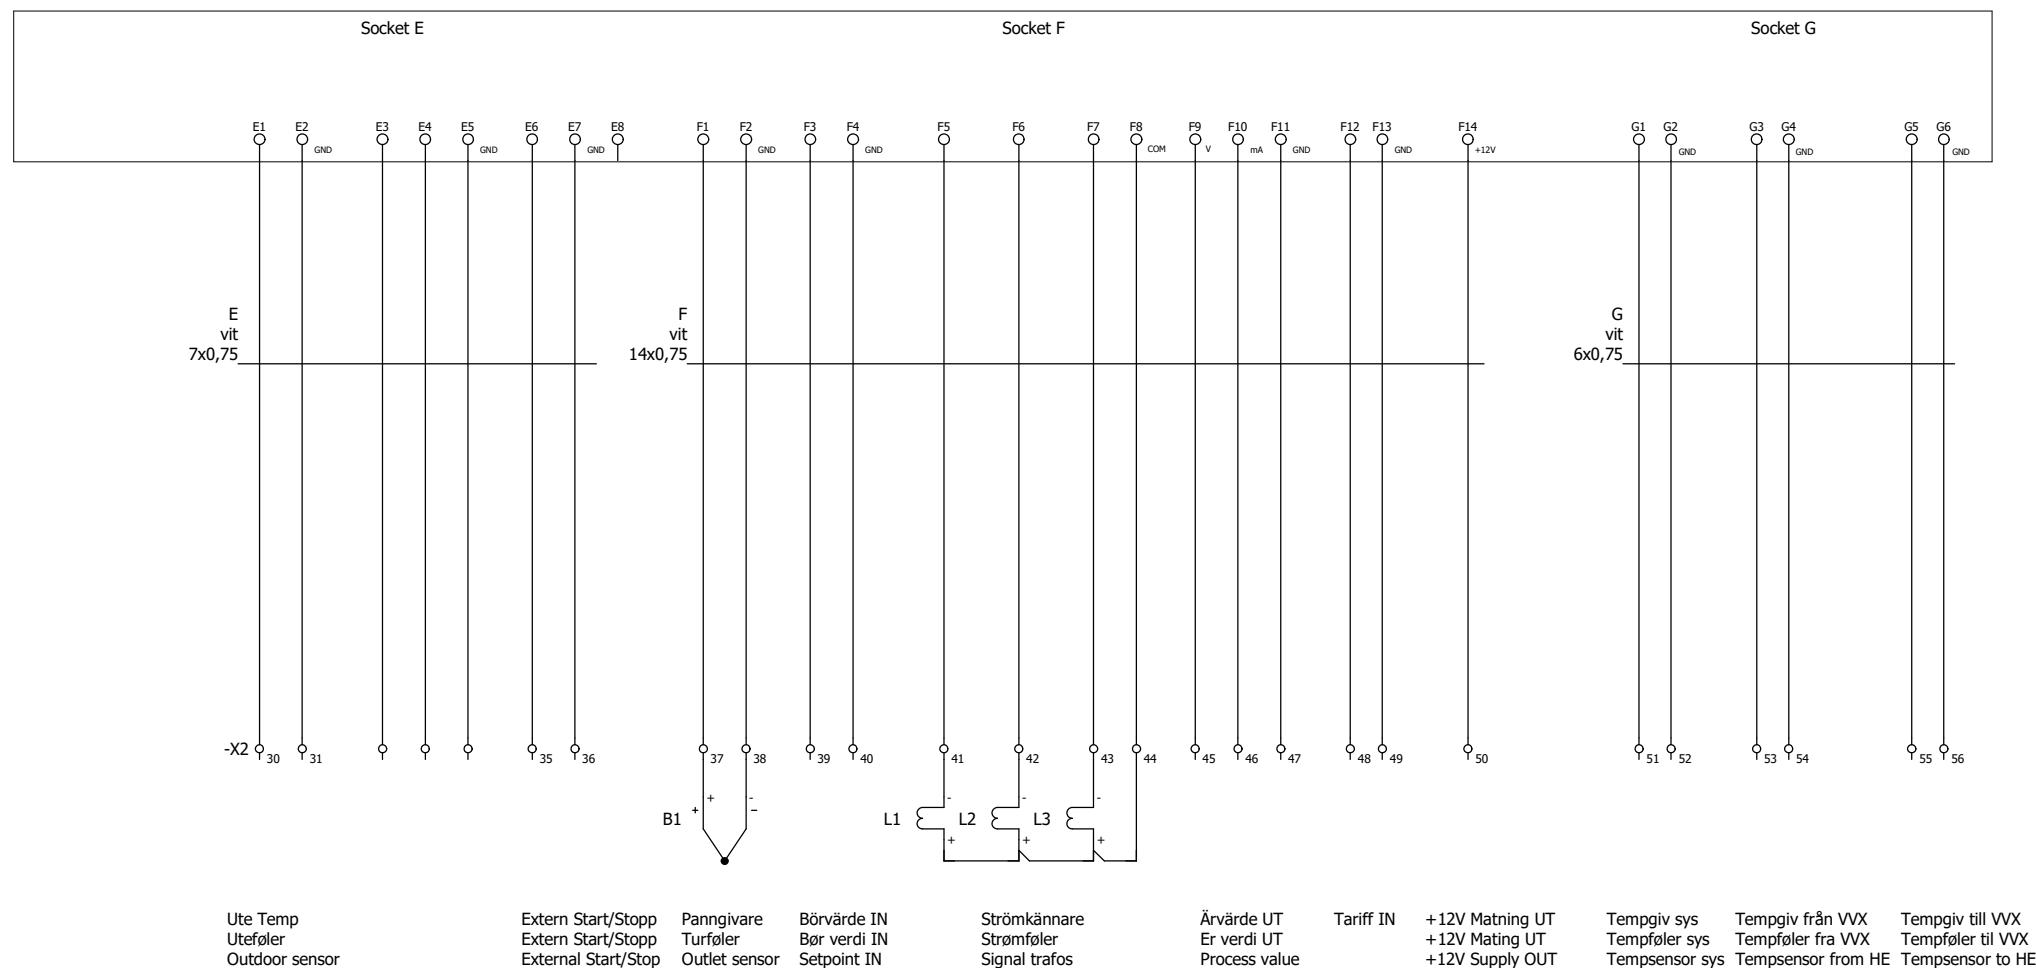



F01_001

[illegible]

Pos	Kodnamn	Benämning	Mängd	Anmärkning
	7612000-05	Elpatron 9kW / 230/400V / 2" gänga	1	
	7612000-14	Elpatron 21kW / 400V / 2" gänga	7	
	3368-3213	Automatsäkring 2-polig 6A 10kA	1	
	3342-3391	Säkringsplint	1	
	3346-0203	Finsäkring 250mA snabb	1	
	3368-3207	Automatsäkring 3-pol 16A	1	
	3368-3210	Automatsäkring 3-polig 32A	1	
	3368-3201	Automatsäkring 3-polig 63A	3	
	3398-3246	Kontaktor AF09-30-10-13 230V	1	
	3398-3260	Kontaktor AF26-30-00-13 230V	1	
	3398-3268	Kontaktor AF52-30-00-13	3	230V
	3342-3601	Fjäderplint 2-vän ZK2.5-PE G/G	3	
	3366-0601	Trycktransmitter 0-16bar	1	
	3395-3253	Universell transmitter 4116 SIL 2	1	
	3395-3254	Displayfront för transmitter 4116	1	
	3354-3028	Huvudbrytare 40A	1	3-pol. OT40M3
	3354-0338	Effektbrytare S250-NE	1	
	3354-0339	Öppningsshunt	1	Öppningsshunt för Terasaki S250
	3354-0317S	Anslutningsklämma 2*150	1	
	3370-0129	Relämodul PLC-RPT-230UC/21HC	2	
	4957-0045	Fördelningsblock UDF 500A	3	
	3342-3602	Fjäderplint 2-vän ZK2.5-D2 grå	26	
	3342-3458	Plintmärkning + (x100)	1	
	3342-3609	Ändplatta EK2.5-D2 / ZK2-D2	1	
	3342-3315	Ändstöd	3	

[illegible]